



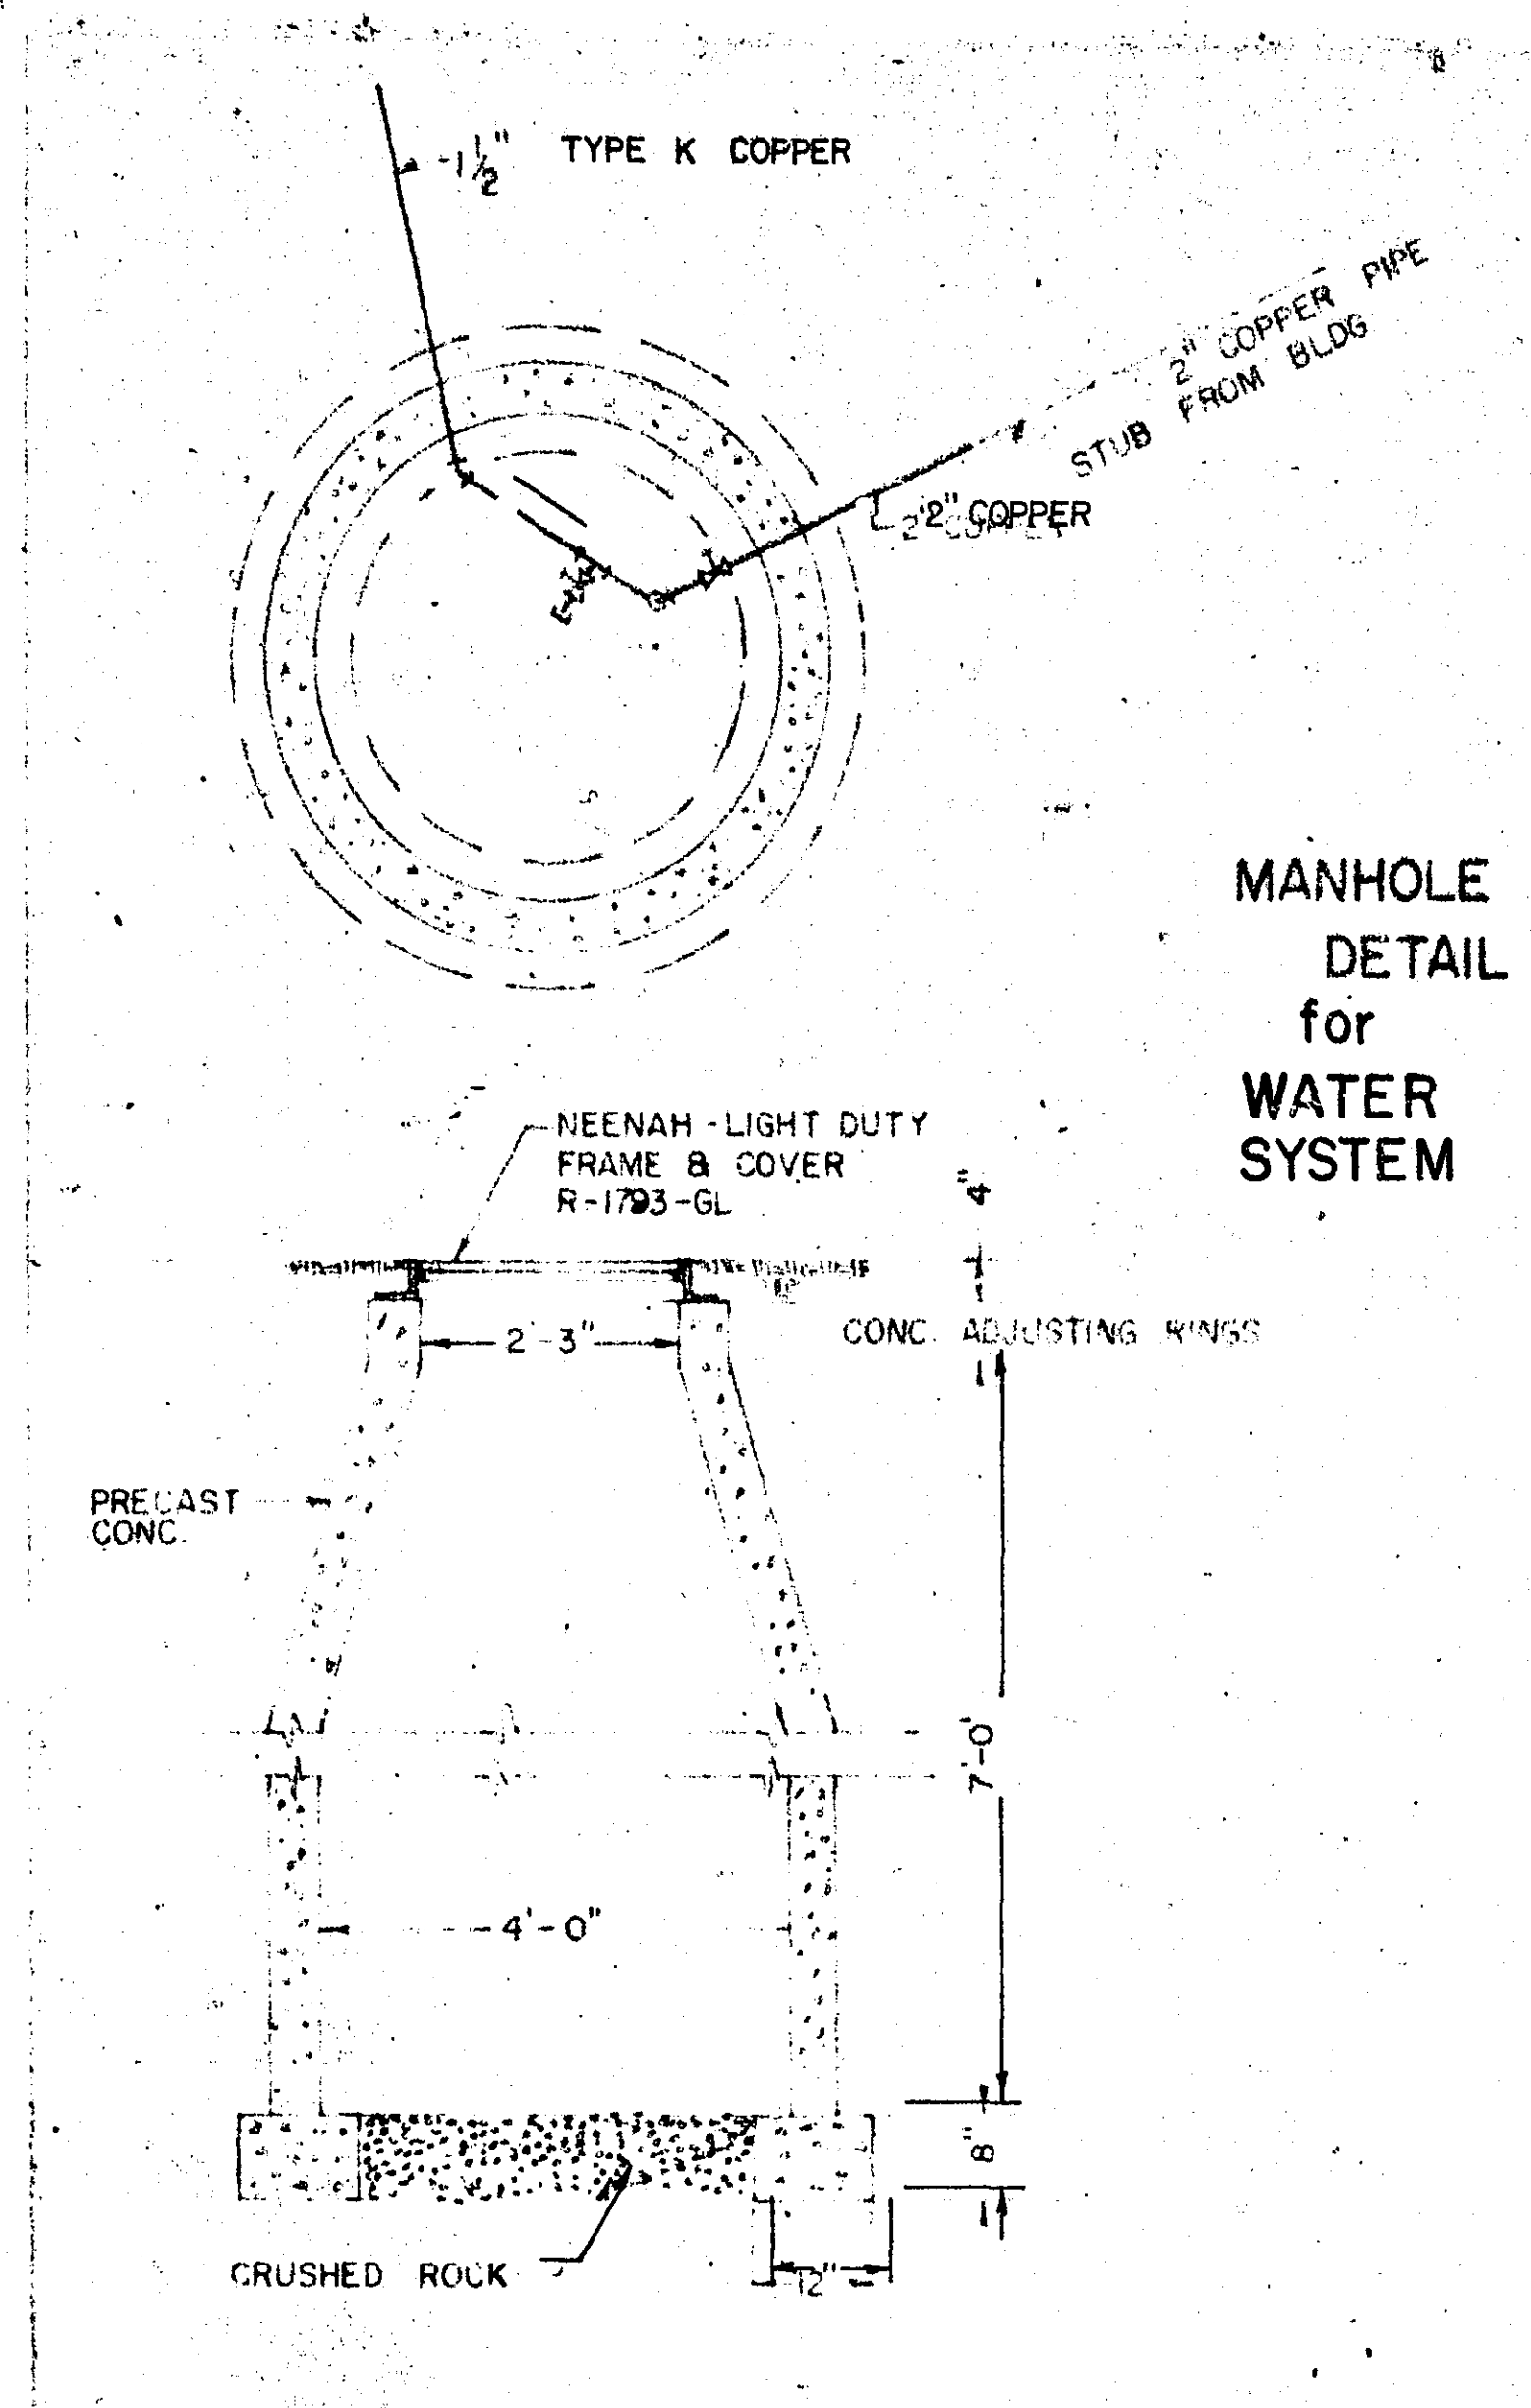

GENERAL NOTES

- 1) THE CONTRACTOR SHALL MAKE THE ARRANGEMENTS WITH THE VILLAGE OF SHOREVIEW FOR THE SEWER CONNECTION AND SHALL ASSUME ANY COSTS INCURRED FOR THIS CONNECTION NOT TO EXCEED \$200.
- 2) BACKFILLING. THE CONTRACTOR SHALL BACKFILL AND COMPACT THE TRENCHES. UNSUITABLE MATERIAL SHALL BE REMOVED AND REPLACED WITH BITUM GRANULAR MATERIAL. IN GRASS AREA THE TOPSOIL SHALL BE REPLACED
- 3) PUMP CONTROLS. CONTROL BOX WILL BE FURNISHED BY RAMSEY COUNTY AND INSTALLED BY CONTRACTOR IN THE CENTER AREA OF THE REFECTORY BLDG.
- 4) ALL WIRING & ELECTRICAL WORK SHALL BE DONE IN ACCORDANCE WITH NATIONAL ELECTRICAL CODE AND ANY VILLAGE OR STATE CODES.
- 5) BURIED CABLE FROM THE CONTROL BOX TO THE WELL SHALL BE A MINIMUM #8 WIRE AND SHALL BE SPECIFICALLY DESIGNED FOR UNDERGROUND WIRING.
- 6) PRESSURE TANK. MINIMUM 300 GALLON, BLACK, A.S.M.E. PRESSURE TANK WITH A MAXIMUM DIA. OF 30" IS REQUIRED TO MOVE TANK INTO BLDG. TANK SHALL HAVE A MINIMUM SAFE WORKING PRESSURE OF 100 P.S.I. INLET & OUTLET OF TANK SHALL BE SIZED FOR 2-INCH PIPE. THE TANK SHALL INCLUDE PRESSURE SWITCH, DRAIN FITTING, AIR CONTROL, PRESSURE GAUGE, AND GATE VALVE. TANK SHALL BE SET AT AN OPERATING PRESSURE RANGE OF 40 TO 60 P.S.I.

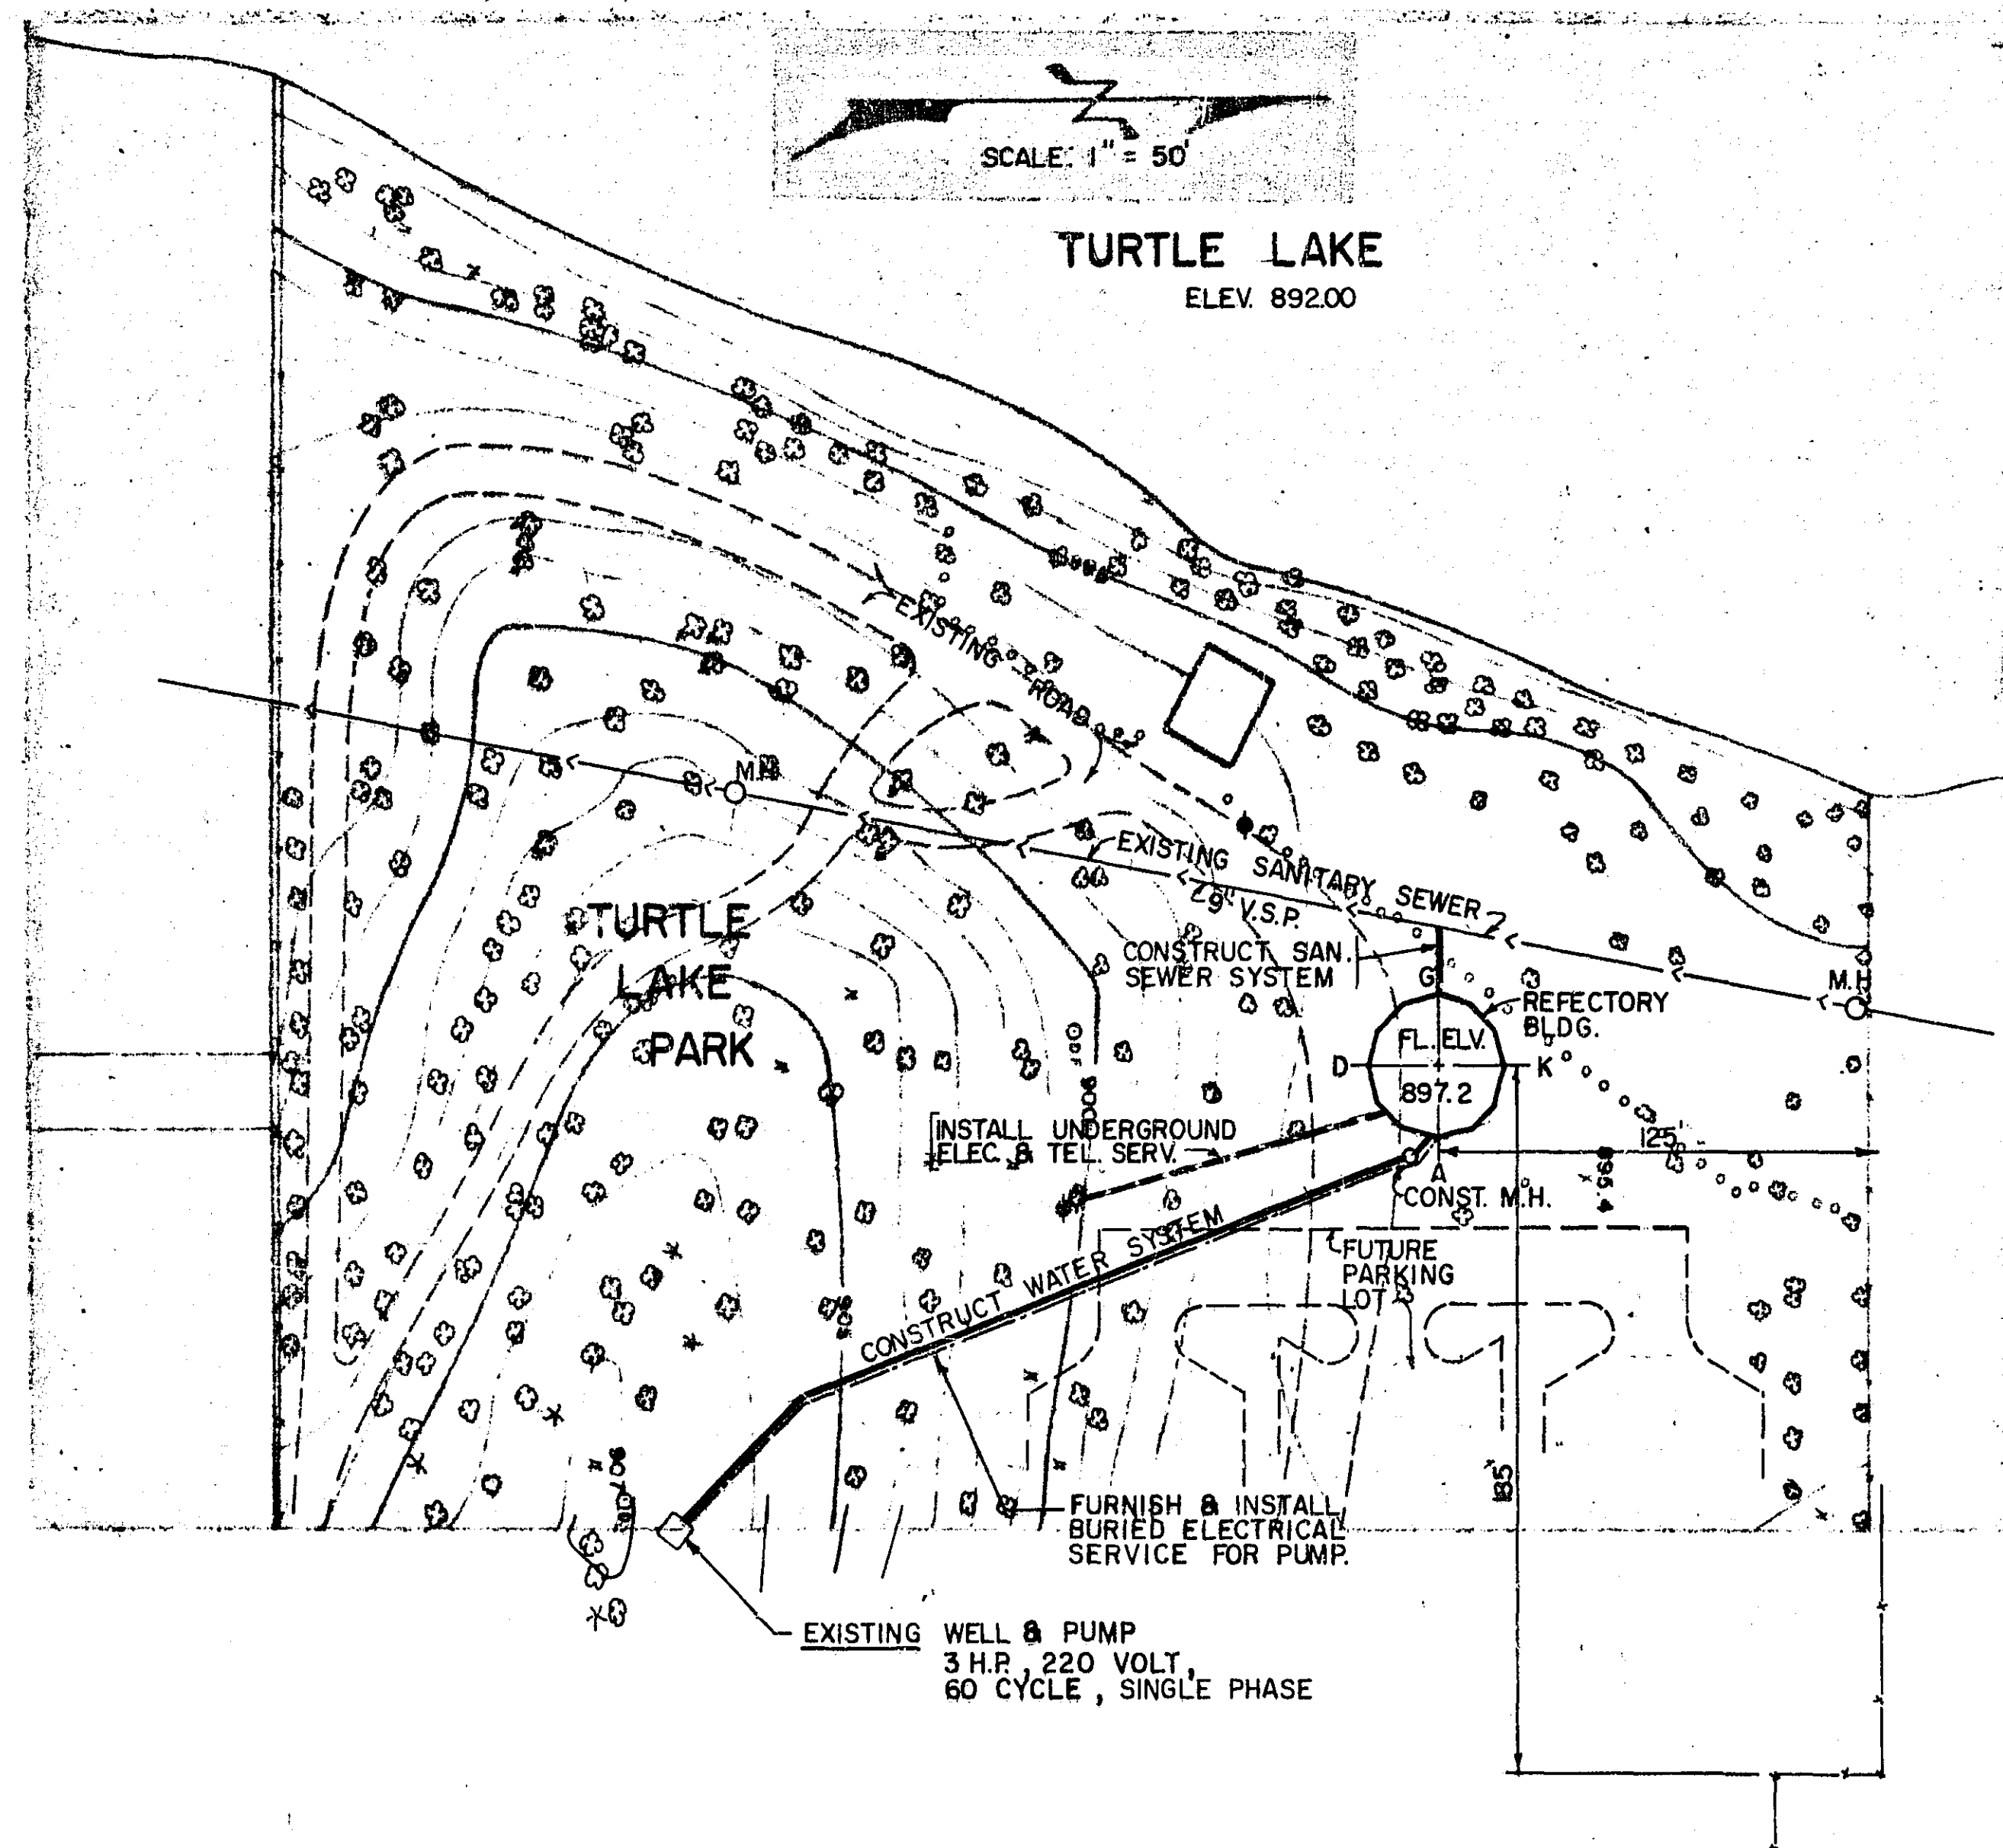